



Engineering Data & Specifications



> Marley

MH Fluid Cooler

Marley / MH Fluid Cooler / Table of Contents

Engineering Data

Schematic – Single-Flow Models	4
Schematic – Double-Flow Models	5
Support	6
Freeze Prevention	7
Water Quality	8

Specifications / Base

Base	9
Thermal Performance	9
Performance Warranty	9
Coil	10
Design Loading	10
Construction	10
Mechanical Equipment	11
Fill, Louvers and Drift Eliminators	12
Distribution Basin	12
Casing, Fan Deck and Fan Guard	12
Access	13
Collection Basin	13
Warranty	13

Specifications / Options

Stainless Steel Options

Stainless Steel Collection Basin	14
Stainless Steel Distribution Basin	14
All Stainless Steel Fluid Cooler	15
Stainless Steel Coil	15

Convenience and Safety Options


Guardrail and Ladder	15
Distribution Basin Access Platform	16
Ladder Extension	16
Ladder Safety Cage	16
Access Door Platform	16
Plenum Walkway	17
Interior Mechanical Equipment Access Platform	17

Control Options

Fan Motor Starter Control Panel	17
Vibration Limit Switch	18
Basin Heater	18
Fan Motor Variable Speed Drive	19

Miscellaneous Options

Dampers	21
Gear Drive	21
Motor Out of the Airstream	21
Premium Efficiency Motor	22
High Temperature Fill	22
Air Inlet Screens	22
FM Approval	22

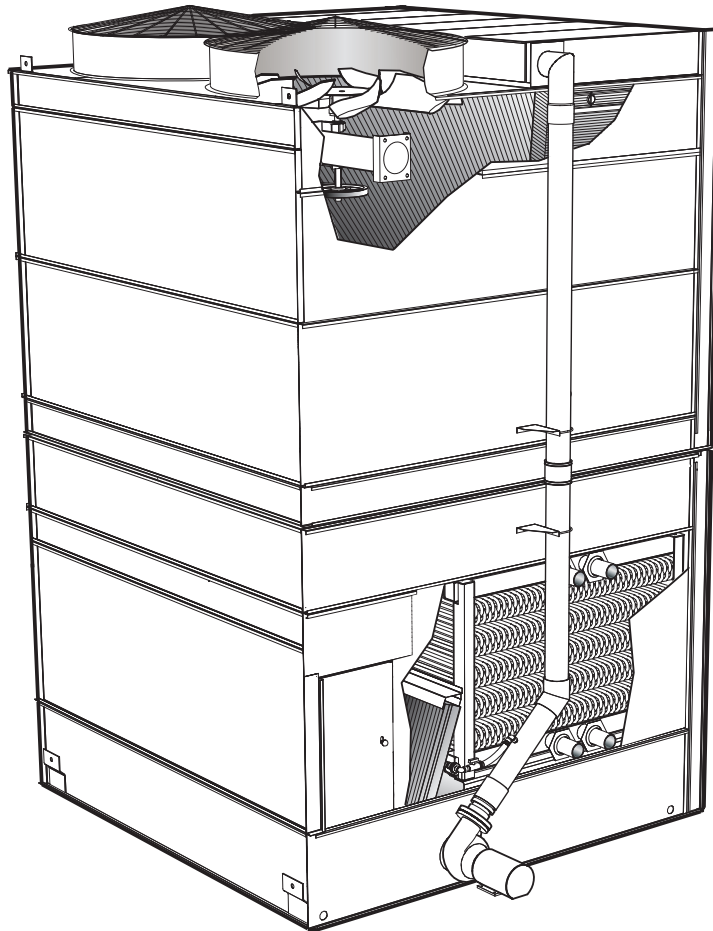


The Marley MH Fluid Cooler is the most efficient system on the market—and your best choice for industrial and HVAC applications. By keeping the process fluid in a clean, closed loop, and combining the function of a cooling tower and heat exchanger into one system, they provide superior operational and maintenance benefits.

The specifications portion of this publication not only relates the language to use in describing an appropriate MH Fluid Cooler—but also defines why certain items and features are important enough to specify with the intention of insisting upon compliance by all bidders. The left hand column of pages 9 thru 22 provides appropriate text for the various specification paragraphs, whereas the right hand column comments on the meaning of the subject matter and explains its value.

Pages 9 thru 13 indicate those paragraphs which will result in the purchase of a basic fluid cooler—one that accomplishes the specified thermal performance, but which will lack many operation—and maintenance-enhancing accessories and features that are usually desired by those persons who are responsible for the continuing operation of the system of which the fluid cooler is part. It will also incorporate those standard materials which testing and experience has proven to provide acceptable longevity in normal operating conditions.


Pages 14 thru 22 provide paragraphs intended to add those features, components, and materials that will customize the fluid cooler to meet the user's requirements.

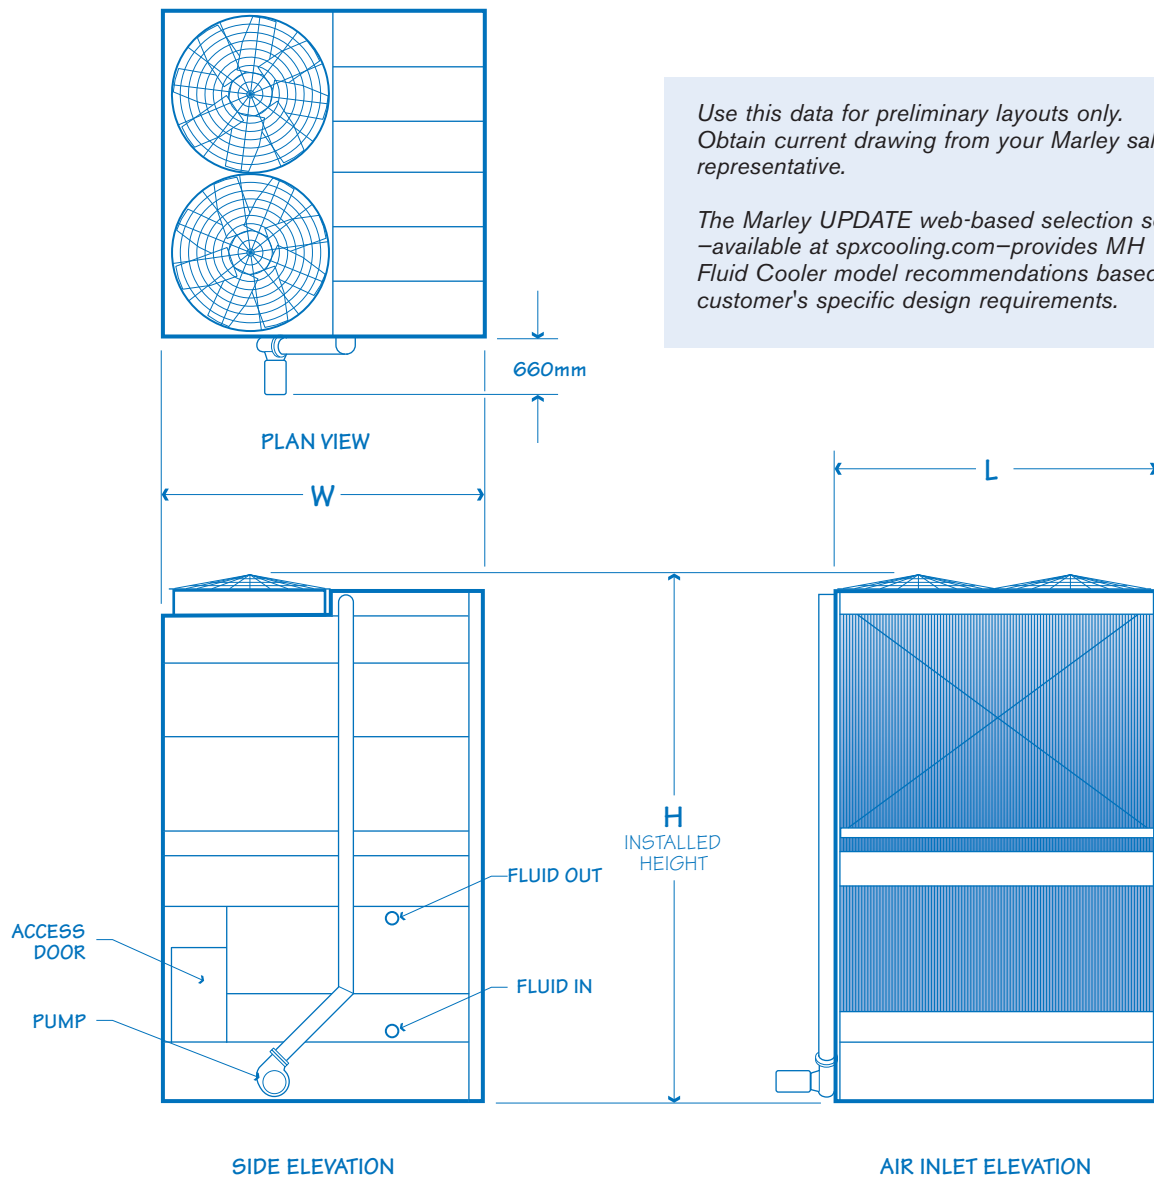


Use this data for preliminary layouts only. Obtain current drawing from your Marley sales representative.

The Marley UPDATE web-based selection software –available at spxcooling.com–provides MH Fluid Cooler model recommendations based on customer's specific design requirements.

Model	Dimensions mm			Shipping Weight kg		Motor kW	Pump kW
	L	W	H	Weight	Heaviest Section		
MHF702	2769	2565	5182	4237	2699	5.60 - 11.19	2.24
MHF703	3683	2565	5182	5080	3289	7.46 - 14.92	3.73
MHF704	3683	3632	5817	7824	5162	11.19 - 22.38	3.73
MHF705	5512	3632	5817	11782	7743	16.79 - 33.57	5.60

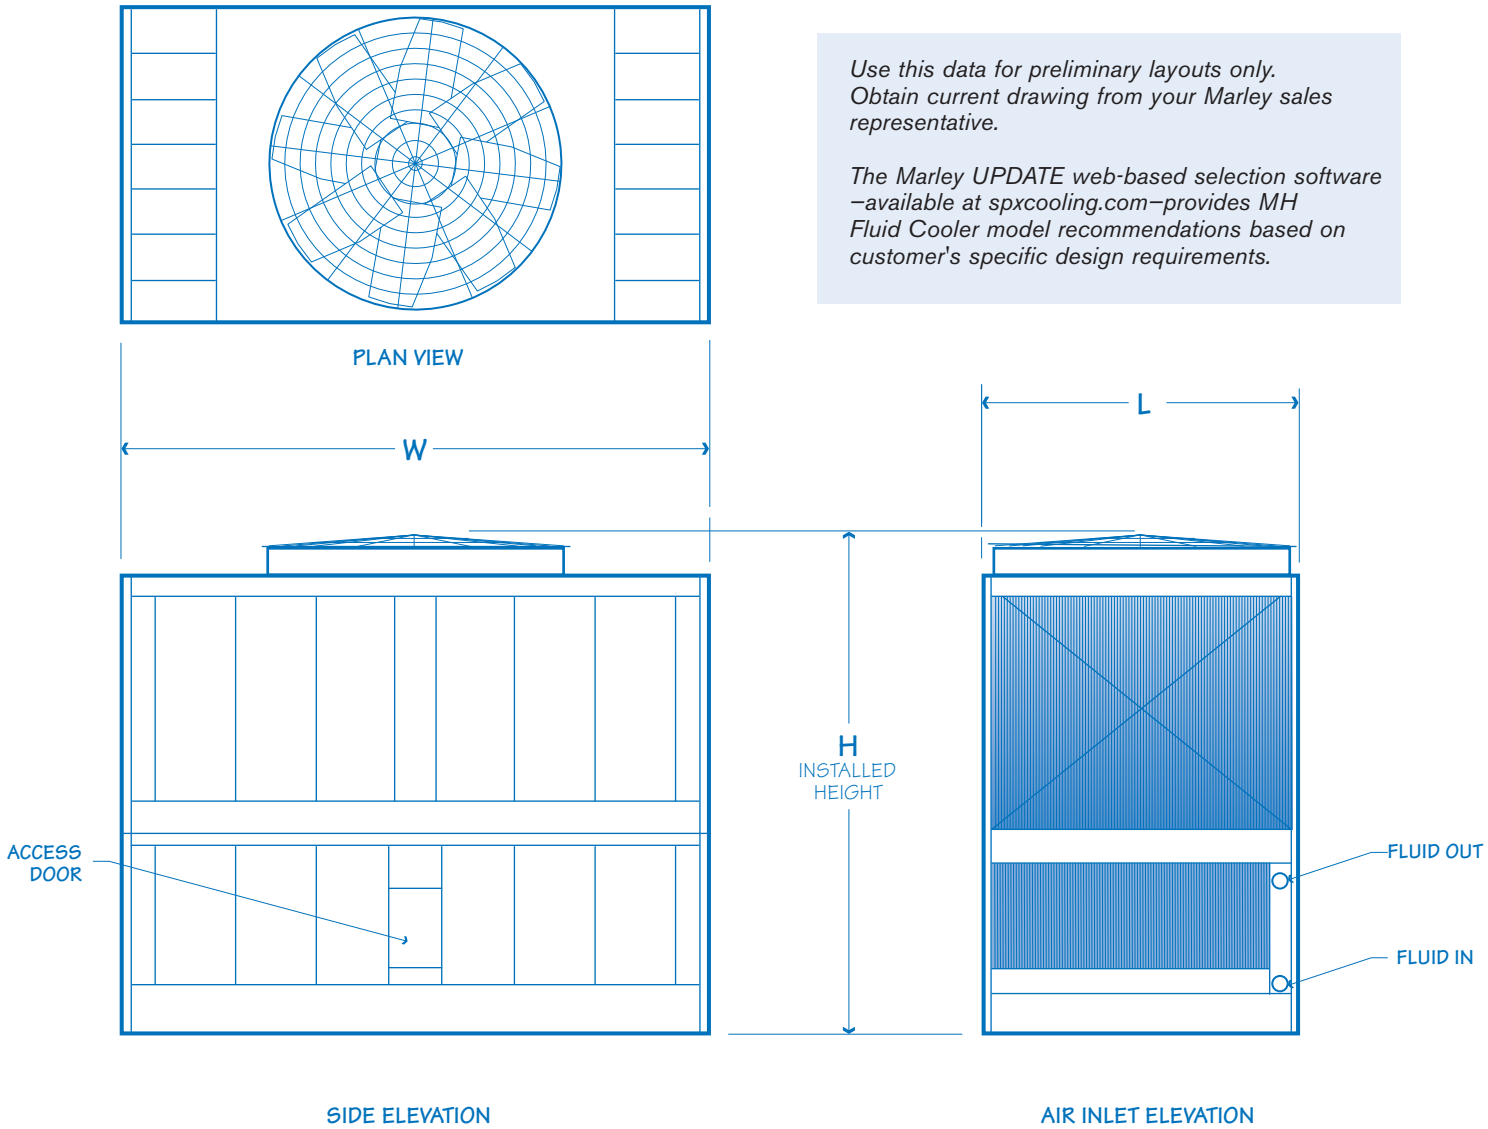

Model	Dimensions mm			Shipping Weight kg		Motor kW	Pump kW
	L	W	H	Weight	Heaviest Section		
MHF706	3632	7264	6706	16279	10936	14.92 - 55.95	2@5.60
MHF707	4242	7874	6706	18738	12719	22.38 - 55.95	2@5.60

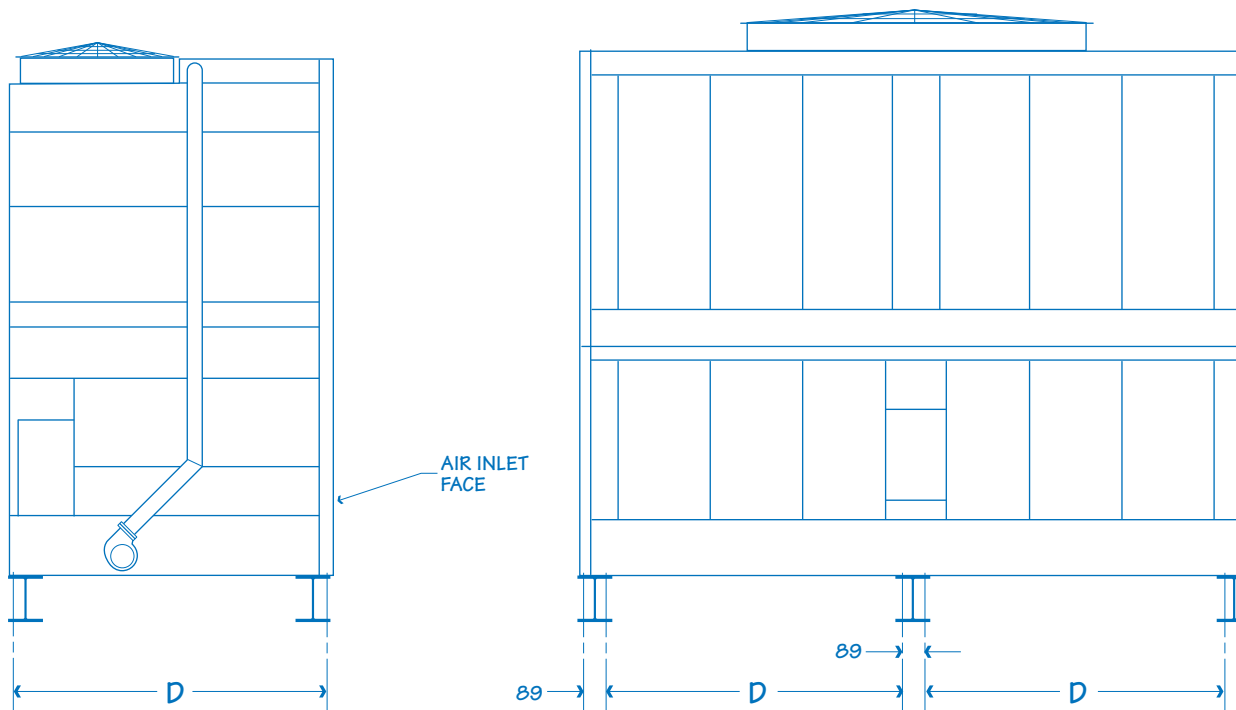

MODELS MHF702 THRU MHF705

MODELS MHF706 AND MHF707

Model	D	Maximum Deflection
MHF702	2515	4.76
MHF703	2515	9.53
MHF704	3581	9.53
MHF705	3581	9.53
MHF706	3432	12.70
MHF707	3737	12.70

Use this data for preliminary layouts only. Obtain detailed support drawings from your Marley sales representative.

Primary support consists of parallel I-beams running the full length of the unit.

Fluid Cooler Coil

When the ambient temperature falls below 0°C, heat loss from the coil be substantial even without recirculating water flowing over the coil. The process fluid, without an applied heat load, may be prone to freezing. There are various methods to protect against coil freezing.

Ethylene and propylene glycol solutions are the best means to protect against coil freezing and are recommended for most installations. The appropriate concentration of ethylene or propylene glycol should be determined based on the required protection from low ambient temperatures.

If the use of an industrial antifreeze solution is not compatible with the system, another accepted method of preventing coil freezing is to maintain a sufficient flow rate and heat load on the process fluid. The fluid exiting the coil must be maintained at or above 7°C at the full process flow rate. If the process load does not yield such a heat load, it may be necessary to apply a supplementary heat load to the process fluid.

Draining the coil is *not* considered to be an acceptable means of protection against freezing. Introducing air to the interior of the bundle will promote corrosion of the heat exchanger coil. In an emergency, this alternative can be used in the event that the process fluid drops below 45°F, the ambient temperature is below freezing and the coils are not protected with industrial antifreeze.

Cycling of the recirculating water pumps should *not* be used to control process flow temperatures. Coils may be used for seasonal dry operation followed by seasonal wet operation, but *not* for frequent cycling of the recirculating water pump. Such operation may lead to an excessive scale buildup resulting in a decrease in efficiency.

CAUTION

Freezing ambient conditions could cause significant damage to the heat exchanger coil of the MH Fluid Cooler. To avoid possible damage, it is imperative to provide for adequate freeze protection.

Fluid Cooling Recirculating Water

When the ambient air temperature falls below 0°C, the recirculating water within the fluid cooler can freeze. *Marley Technical Report #H-003 "Operating Cooling Towers in Freezing Weather"* describes how to prevent freezing during operation. Ask your Marley sales representative for a copy or download a copy at spxcooling.com.

During shutdown, water collects in the basin and may freeze solid. You can prevent freezing by adding heat to the water left in the basin—or, you can drain the tower and all exposed pipework at shutdown.

Electric Basin Heaters

An automatic basin water heater system, consisting of the following components:

- Stainless steel electric immersion heater(s). Threaded couplings are provided in the side of the collection basin.
- IP56 enclosure containing: Magnetic contactor to energize heater. Transformer to convert power supply to 24 volts for control circuit. Solid state circuit board for temperature and low-water cutoff.
The enclosure may be mounted on the side of the fluid cooler.
- Control probe in the collection basin to monitor water temperature and level.
- Heat tracing for recirculating water pump.

The basin heater option is only for freeze protection of the recirculation water in collection basin. The basin heater option does *not* protect the coil during freezing weather.

Heater components are normally shipped separately for installation by others.

Indoor Storage Tank

With this type of system, water flows from an indoor tank and back to the tower where it is cooled and recirculated. The water flows by gravity from the fluid cooler to the tank located in a heated space. At shutdown, all exposed water drains into the tank where it is safe from freezing.

The amount of water needed to successfully operate the system depends on the fluid cooler size and L/s and on the volume of water contained in the piping system to and from the tower. You must select a tank large enough to contain those combined volumes—plus a level sufficient to maintain a flooded suction on your pump. Control makeup water according to the level where the tank stabilizes during operation.

The MH Fluid Cooler can be a very effective air washer. Atmospheric dust able to pass through the relatively small louver openings will enter the recirculating water system. Increased concentrations can intensify systems maintenance by clogging screens and strainers—and smaller particulates can coat system heat transfer surfaces. In areas of low flow velocity—such as the collection basin—sedimentary deposits can provide a breeding ground for bacteria.

In areas prone to dust and sedimentation, you should consider installing some means for keeping the collection basin clean. Typical devices include side stream filters and a variety of filtration media.

Blowdown

Blowdown or Bleedoff is the continuous removal of a small portion of the water from the open recirculating system. Blowdown is used to prevent the dissolved solids from concentrating to the point where they will form scale. The amount of blowdown required depends on the cooling range—the difference between the hot and cold water temperatures of the closed circuit— and the composition of the makeup water. The MH Fluid Cooler is equipped with a blowdown line with metering valve connected directly to the overflow. Specific blowdown adjustment instructions and additional blowdown information can be found in the *MH Fluid Cooler User Manual*.


CAUTION

The fluid cooler must be located at such distance and direction to avoid the possibility of contaminated discharge air being drawn into building fresh air intake ducts. The purchaser should obtain the services of a Licensed professional Engineer or Registered Architect to certify that the location of the fluid cooler is in compliance with applicable air pollution, fire and clean air codes.

Water Treatment


To control the buildup of dissolved solids resulting from water evaporation, as well as airborne impurities and biological contaminants including Legionella, an effective consistent water treatment program is required. Simple blowdown may be adequate to control corrosion and scale, but biological contamination can only be controlled with biocides.

An acceptable water treatment program must be compatible with the variety of materials incorporated in a fluid cooler—ideally the pH of the recirculating water should fall between 6.5 and 9.0. Batch feeding of the chemicals directly into the fluid cooler is not a good practice since localized damage to the fluid cooler is possible. Specific startup instructions and additional water quality recommendations can be found in the *MH Fluid Cooler User Manual* which accompanies the fluid cooler and also is available from your local Marley sales representative. For complete water treatment recommendations and services contact your local Marley sales representative.


Specifications	Specification Value
<p>1.0 Base:</p> <p>1.1 Furnish and install an induced-draft, crossflow-type, factory assembled, galvanized steel, closed circuit fluid cooler. Unit shall consist of ____ cell(s), as shown on plans. The limiting overall dimensions of the tower shall be ____ wide, ____ long, and ____ high to the top of the fan guard. Total operating kilowatts of all fans shall not exceed ____ kW, consisting of ____ @ ____ kW motor(s). Tower shall be similar and equal in all respects to Marley Model ____.</p> <p>2.0 Thermal Performance:</p> <p>2.1 <i>Water as the heat transfer fluid.</i> The fluid cooler shall be capable of cooling ____ m³/hr of water from ____ °C to ____ °C at a design entering air wet-bulb temperature of ____ °C. Coil pressure drop shall not exceed ____ kPa. The thermal performance rating shall be Certified by the Cooling Technology Institute.</p> <p>2.1 <i>Aqueous glycol solution as the heat transfer fluid.</i> The fluid cooler shall be capable of cooling ____ m³/hr of water from ____ °C to ____ °C at a design entering air wet-bulb temperature of ____ °C. Coil pressure drop shall not exceed ____ kPa. The thermal performance rating shall be based on the Cooling Technology Institute certified performance rating adjusted for the thermal properties of the aqueous glycol solution used.</p> <p>3.0 Performance Warranty:</p> <p>3.1 CTI Certification notwithstanding, the cooling tower manufacturer shall guarantee that the fluid cooler supplied will meet the specified performance conditions when the tower is installed according to plans. If, because of a suspected thermal performance deficiency, the owner chooses to conduct an on-site thermal performance test under the supervision of a qualified, disinterested third party in accordance with CTI or ASME standards during the first year of operation; and if the tower fails to perform within the limits</p>	<p>■ Your specification base establishes the type, configuration, base material, and physical limitations of the fluid cooler to be quoted. During the planning and layout stages of your project, you will have focused your attention on a fluid cooler selection that fits your space allotment, and whose power usage is acceptable. Limitations on physical size and total operating horsepower avoid the introduction of unforeseen operational and site-related influences. Specifying the number of cells, and the maximum fan hp/cell will work to your advantage.</p> <p>The benefit of crossflow fluid coolers is that they are inherently easy to operate, access, and maintain. Unlike counterflow fluid coolers, crossflow fluid coolers have a spacious plenum between banks of fill for easy access to all of the tower's internal components, and the water distribution system is adjacent to the fan deck.</p> <p>■ CTI Certification means that the fluid cooler has been tested under operating conditions and found to perform as rated by the manufacturer under those circumstances. It assures the buyer that the tower is not intentionally or inadvertently undersized by the manufacturer.</p> <div style="text-align: right;">  </div> <p>■ However, CTI certification alone is not sufficient to assure you that the fluid cooler will perform satisfactorily in your situation. Certification is established under relatively controlled conditions, and fluid coolers seldom operate under such ideal circumstances. They are affected by nearby structures, machinery, enclosures, effluent from other sources, etc. Responsible and knowledgeable bidders will take such site-specific effects into consideration in selecting the fluid cooler—but the specifier must insist by the written specification that the designer/manufacturer guarantee this “real world” performance. Any reluctance on the part of the bidder should cause you some concern.</p>




Specifications	Specification Value
<p>of test tolerance; then the fluid cooler manufacturer will pay for the cost of the test and will make such corrections as are appropriate and agreeable to the owner to compensate for the performance deficiency.</p>	
<p>4.0 Coil:</p>	
<p>4.1 Coil(s) shall consist of fully welded box headers with serpentine coils and hot-dip galvanized after fabrication. Maximum operating design pressure shall be 1379 kPa. The coil shall be designed for free drainages of fluid at shutdown. Coil shall be warranted against any failure caused by defects in materials and workmanship for a period of eighteen (18) months from the date of tower shipment.</p>	<p>■ The MH Fluid Cooler coil is suitable for cooling water, oils, and other fluids compatible with carbon steel in a closed, pressurized system. Each coil is constructed of all-prime surface, continuous steel tubing, formed into a serpentine shape and welded into an assembly. Tubes are sloped to provide free drainage when vented.</p> 
<p>5.0 Design Loading:</p>	
<p>5.1 The structure and anchorage shall be designed to withstand a wind load of 960 Pa on single-flow models and 1440 Pa on double-flow models while operating. The structure and anchorage shall be designed to withstand a seismic load of .11g on single-flow models and .18g on double-flow models while operating. The fluid cooler shall be designed to withstand shipping and hoisting loads of 2g horizontal or 3g vertical. The fan deck and hot water basin covers on double-flow models shall be designed for 2.42 kPa live load or a 91 kg concentrated load. Guardrails, where specified, shall be capable of withstanding a 890N concentrated live load in any direction, and shall be designed in accordance with OSHA guidelines.</p>	<p>■ The indicated design values are the minimum allowables under accepted design standards. They give you assurance that the fluid cooler can be shipped, handled, hoisted—and ultimately operated in a normal cooling tower environment. Most MH Fluid Cooler models will withstand significantly higher wind and seismic loads. If your geographic location dictates higher wind load or seismic load values, please make the appropriate changes, after discussion with your Marley sales representative.</p>
<p>6.0 Construction:</p>	
<p>6.1 Except where otherwise specified, all components of the fluid cooler shall be fabricated of heavy-gauge steel, protected against corrosion by Z600 galvanizing. After passivation of the galvanized steel (8 weeks at pH 7-8, and calcium hardness and alkalinity at 100-300 mg/L each), the fluid cooler shall be capable of withstanding water having a pH of 6.5 to 9.0; a chloride content up to 500 ppm as NaCl (300 mg/L as Cl⁻); a sulfate content (as SO₄) up to 250 mg/L; a calcium content (as CaCO₃) up to 500 mg/L; silica (as SiO₂) up to 150 mg/L;</p>	<p>■ In the history of fluid coolers, no other coating for carbon steel has exhibited the success and longevity of galvanization in exposure to the normal cooling tower water quality defined at left. No paints or electrostatically-applied coatings, however exotic they may be, can approach galvanization's history of success.</p> <p>If extended longevity of the fluid cooler is required—or unusually harsh operating conditions are expected—consider specifying stainless steel as either the base construction material, or the material utilized for specific components of your choice. See Stainless Steel Options on page 12.</p>

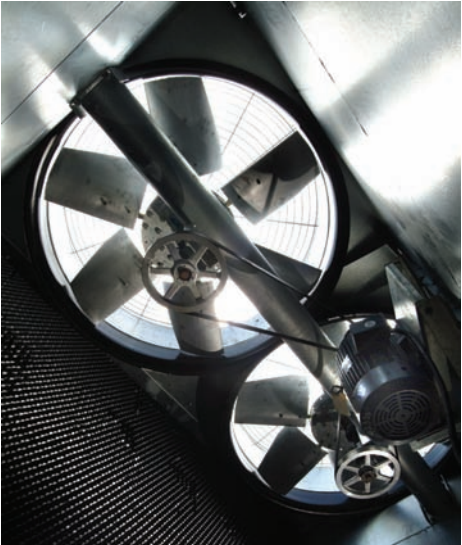Specifications	Specification Value
<p>and design operating ranges up to 28°C. The circulating water shall contain no oil, grease, fatty acids, or organic solvents.</p> <p>6.2 The specifications, as written, are intended to indicate those materials that will be capable of withstanding the above water quality in continuing service, as well as the loads described in paragraph 6.1. They are to be regarded as minimum requirements. Where component materials unique to individual tower designs are not specified, the manufacturers shall take the above water quality and load carrying capabilities into account in the selection of their materials of manufacture.</p> <p>7.0 Mechanical Equipment:</p> <p>7.1 Fan(s) shall be heavy-duty, axial flow design. Fan(s) shall be driven through an industrial grade system of V-belts, pulleys, and tapered roller bearings. Bearings shall be rated at an L₁₀ life of 40,000 hours, or greater.</p> <p>7.2 Motor(s) shall be ____ kW maximum, Totally Enclosed, 1.15 service factor, variable torque, and specially insulated for cooling tower duty. Speed and electrical characteristics shall be 1500 RPM, single-winding, 3 phase, 50 hertz, ____ volts.</p> <p>7.3 The fan and fan drive assembly for each cell shall be supported by a rigid, galvanized steel structural support that resists misalignment. The mechanical equipment assembly shall be warranted against any failure caused by defects in materials and workmanship for no less than five (5) years following the date of tower shipment. This warranty is limited to the fan, fan shaft, bearings, sheaves and mechanical equipment support. The motor, motor components, pumps and belt(s) are warranted by their manufacturer.</p>	<p>■ Propeller-type fans require only half the operating hp of blower-type fans. The Marley drive system features all-aluminum sheaves, matched belts, and long-life bearings for dependable service.</p> <p>To reduce cost, some manufacturers may use TEAO motors, whose only source of cooling is the flow of air produced by the cooling tower fan. They are sometimes applied at kW's significantly beyond their nameplate rating.</p> <p>Unless otherwise specified, motor speed will be 1500 RPM, 50 Hertz on standard models. If you prefer the operating flexibility of two-speed operation, please specify two-speed, single-winding motors which offer full and half speeds for maximum energy savings. Incidentally, two speed motors are a far better choice than separate "pony" motors which simply double the problems indicated above.</p> <p>The value of a 5 year mechanical equipment warranty speaks for itself.</p> 

Specifications	Specification Value
<p>8.0 Fill, Louvers and Drift Eliminators:</p> <p>8.1 Fill shall be film-type, thermoformed of 0.38 mm thick PVC, with louvers and eliminators formed as part of each fill sheet. Fill shall be suspended from galvanized structural tubing supported from the tower structure.</p> <p>8.2 Coil louvers and eliminators shall be film-type, thermoformed of 0.43mm thick PVC and shall be easily removable for access to tube bundle</p> <p>8.3 Fill and coil drift eliminators shall be triple-pass, and shall limit drift losses to no more than 0.005% or less of the design water flow rate of the recirculating water. The air inlet face of the tower shall be free of water splash-out.</p> <p>9.0 Distribution Basins:</p> <p>9.1 An open basin above the fill with removable interchangeable polypropylene nozzles installed in the floor of the basin shall provide full coverage of the fill by gravity flow. Basin shall be installed and sealed at the factory and shall be equipped with removable, galvanized steel covers.</p> <p>9.2 A redistribution basin below the fill with polypropylene nozzles installed in the floor of the basin shall provide full coverage of the coil at a flow rate sufficient to ensure complete wetting of the coil at all times.</p> <p>10.0 Casing, Fan Deck and Fan Guard:</p> <p>10.1 The casing and fan deck shall be heavy gauge Z600 galvanized steel panels. The top of the fan cylinder(s) shall be equipped with a conical, non-sagging, removable fan guard, fabricated of welded 8mm and 7 gauge rods and hot-dip galvanized after fabrication.</p>	<ul style="list-style-type: none"> ■ Louvers integral with the fill keep the flowing water within the confines of the fill. The separate external louvers used by others permit water to escape the fill and form ice or produce an unsightly situation adjacent to the tower. If you plan to use your tower in the wintertime, particularly for free cooling, integral louvers will put your operating concerns to rest. ■ Drift rate varies with design water loading and air rate, as well as drift eliminator depth and number of directional changes. A drift rate of 0.001% is readily available on many standard models. If a lower rate is required, please discuss with your Marley sales representative. ■ Gravity-flow distribution basins are a feature of the MH Fluid Cooler resulting in operating pump heads less than that encountered in fluid coolers with pressurized spray systems. Also, these basins are out where they can be easily inspected—even maintained—while the fluid cooler is in operation. Spray systems are extremely awkward to access and maintain. <p>Also, the plastic basin covers offered by some manufacturers are incapable of supporting the loads imposed in maintenance. They will, therefore, tell you that it is really unnecessary for you to ever go to the top of their towers and—if you do have to—that it is better for you to work from the top of a portable ladder!</p> <ul style="list-style-type: none"> ■ Manufacturers who use materials other than heavy-gauge steel for fan decks may be unable to meet your specified loading requirements. Fan decks on the larger models—MHF706 and MHF707—are designed to be used as a working platform.

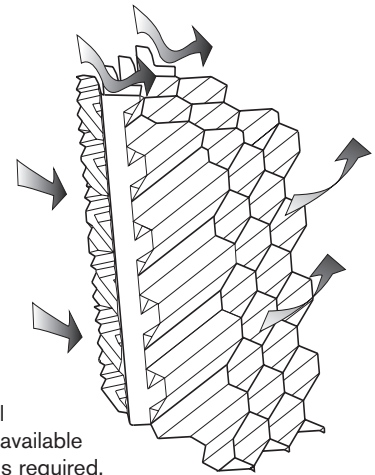

Specifications	Specification Value
<p>11.0 Access:</p> <p>11.1 A large galvanized, hinged, steel access door 711mm wide and 1066mm high shall be located on both endwalls for entry into the cold water basin and fan plenum area. Access doors shall be operable from inside as well as outside the tower.</p> <p>12.0 Collection Basin:</p> <p>12.1 The collection basin shall be heavy-gauge galvanized steel. Suction connections shall be equipped with galvanized debris screens. A factory-installed, float-operated, mechanical makeup valve and waste water blowdown line shall be included. A 4" diameter PVC drain and overflow shall be provided in each cell of the tower. The basin shall include a depressed section into which accumulated silt can be flushed to permit cleaning. The basin floor adjacent to the depressed section shall slope toward the depressed section to prevent buildup of silt under the coil area.</p> <p>12.2 Recirculation pump(s) shall be mounted to the collection basin in conjunction with a suction assembly. Recirculation piping shall be schedule 40 PVC. A blowdown line with metering valve shall be connected directly to the tower overflow.</p> <p>13.0 Warranty:</p> <p>13.1 The fluid cooler shall be free from defects in materials and workmanship for a period of eighteen (18) months from the date of shipment.</p>	<p>■ Access doors on other manufacturer's towers may be 18" wide or smaller, which is unreasonably small for a human being. Specifying the size of the door will cause those bidders to take exception, alerting you to a potential maintenance headache. Two doors are standard on all MH Fluid Coolers—one in each endwall.</p> <p>The removable-standpipe type of overflow is valuable because it provides a way to achieve flush-out cleanability. Other drains may be as little as 25mm diameter, making flush-out cleaning impractical at best.</p>  <p>Location of the coil in the lower portion of the MH Fluid Cooler makes it much easier to access for cleaning and inspection.</p> 

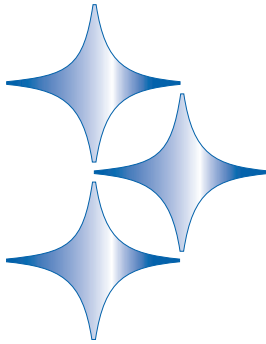Specifications	Specification Value
<p>Stainless Steel Options</p>	
<p>Stainless Steel Collection Basin:</p>	
<p><u>12.1:</u> <i>Replace paragraph 12.1 with the following:</i> The cold water basin shall be heavy-gauge series 300 welded stainless steel. Suction connections shall be equipped with stainless steel debris screens. A factory-installed, float-operated, mechanical makeup valve and waste water blowdown line shall be included. A 4" diameter PVC drain and overflow shall be provided in each cell of the tower. The basin shall include a depressed section into which accumulated silt can be flushed to permit cleaning. The basin floor adjacent to the depressed section shall slope toward the depressed section to prevent buildup of silt under the coil area. All steel items which project into the basin (coil supports, anchor clips, etc) shall also be made of stainless steel.</p>	<ul style="list-style-type: none"> ■ The cold water basin is the only part of the tower that is subject to periods of stagnant water, concentrated with treatment chemicals and customary contaminants. It is also the most expensive and difficult part of any tower to repair or replace. For these reasons, many customers—particularly those who are replacing older towers—choose to specify stainless steel cold water basins.
	
<p>Stainless Steel Distribution Basin:</p>	
<p><u>9.1</u> <i>Replace paragraph 9.1 with the following:</i> An open stainless steel basin above the fill with removable interchangeable polypropylene nozzles installed in the floor of the basin shall provide full coverage of the fill by gravity flow. Basin shall be installed and sealed at the factory and shall be equipped with removable, stainless steel covers capable of withstanding the loads described in paragraph 5.1. All components of these basins with the exception of the nozzles and redistribution piping shall be stainless steel.</p>	<ul style="list-style-type: none"> ■ It would also be advisable to change the fill support tubes in Paragraph 8.1 from galvanized structural tubing to 300 stainless steel structural tubing.
<p><u>9.2</u> <i>Replace paragraph 9.2 with the following:</i> A redistribution basin below the fill with removable interchangeable polypropylene nozzles installed in the floor of the basin shall provide full coverage of the coil at a flow rate sufficient to ensure complete wetting of the coil at all times. All components of the basin with the exception of the nozzles shall be stainless steel.</p>	

Specifications	Specification Value
<p>All Stainless Fluid Cooler:</p> <p>6.1 <i>Replace paragraph 6.1 with the following:</i> Except where otherwise specified, all components of the fluid cooler shall be fabricated of heavy-gauge, series 300 stainless steel. The tower shall be capable of withstanding water having a chloride content (NaCl) up to 750 mg/L; a sulfate content (SO4) up to 1200 mg/L; a calcium content (CaCO3) up to 800 mg/L; silica (SiO2) up to 150 mg/L; and design operating ranges up to 28°C. The circulating water shall contain no oil, grease, fatty acids, or organic solvents.</p> <p>Stainless Steel Coil:</p> <p>4.1 <i>Replace paragraph 4.1 with the following:</i> Coil(s) shall consist of fully welded box headers with serpentine coils. All coil components shall be assembled from series 300 stainless steel. Maximum operating design pressure shall be 1379 kPa. The coil shall be designed for free drainages of fluid at shutdown. Coil shall be warranted against any failure caused by defects in materials and workmanship for a period of eighteen (18) months from the date of tower shipment.</p> <p>Convenience and Safety Options</p> <p>Guardrail and Ladder: <i>MHF706 and MHF707 models only</i></p> <p>11.2 <i>Add the following paragraph in the Access section:</i> The top of the fluid cooler shall be equipped with a sturdy guardrail, complete with kneerail and toeboard, designed according to OSHA guidelines. Guardrails and kneerails shall consist of 42mm O.D. x 15 gauge galvanized structural tubing, the guardrail of which shall be capable of withstanding a 890N concentrated live load in any direction. Posts are 51mm x 51mm square structural tubing and shall be spaced on centers of 2438mm or less. A 457mm wide aluminum ladder with 76mm I-beam side rails and 32mm diameter rungs shall be permanently attached to the endwall casing of the fluid cooler, rising from the base of the fluid cooler to the top of the guardrail.</p>	<ul style="list-style-type: none"> ■ For pure resistance to corrosion—coupled with the capability to meet stringent fire and building codes—there is no substitute for stainless steel. No paints or electrostatically-applied coatings, however exotic they may be, can match stainless steel's ability to withstand adverse operating conditions. ■ For process fluids that are not compatible with the standard galvanized steel construction, stainless steel offers you the ultimate in corrosion resistance and long life. The thermal performance rating shall be based on the Cooling Technology Institute certified performance rating adjusted for the thermal properties of stainless steel. ■ Good maintenance practice requires periodic access to the top of the fluid cooler to inspect the distribution basins as well as the structural integrity of the fan deck, fan guard, fan cylinder and fan—especially the fan blade securing hardware. These models are large enough to accommodate this convenience. <p>For the comfort and safety of your operating personnel, we recommend that you specify a ladder and guardrail on these models. Portable ladders and other “make-do” access means are inappropriate for equipment of this size and complexity. Also, fixed ladders without fan deck guardrails invite unsafe maintenance practices and must not be allowed.</p>

Specifications	Specification Value
<p>Distribution Basin Access Platform:</p> <p><u>11.2</u> <i>Add the following paragraph in the Access section:</i> Provide an external platform near the top of the louver face for access to the hot water distribution system. The platform shall be heavy gauge galvanized steel with safety grip perforations, supported by galvanized steel framework attached to the fluid cooler. The platform shall be surrounded by a guardrail, kneerail, and toeboard. A permanently attached 457mm wide aluminum ladder with 76 mm I-beam side rails and 32 mm diameter serrated rungs shall extend from the base of the tower to the top of the guardrail.</p> <p>Ladder Extension:</p> <p><u>11.2</u> <i>Add the following to the end of paragraph 11.2:</i> Provide a ladder extension for connection to the foot of the ladder. This extension shall be long enough to rise from the roof (grade) level to the base of the fluid cooler. The installing contractor shall be responsible for cutting the ladder to length; attaching it to the foot of the fluid cooler ladder; and anchoring it at its base.</p> <p>Ladder Safety Cage:</p> <p><u>11.3</u> <i>Add the following paragraph in the Access section:</i> An aluminum safety cage shall surround the ladder, extending from a point approximately 2m above the foot of the ladder to the top of the guardrail surrounding the fan deck or platform.</p> <p>Access Door Platform:</p> <p><u>11.4</u> <i>Add the following paragraph in the Access section:</i> There shall be an access platform at the base of the fluid cooler extending from the vertical ladder to the endwall access door. The platform shall be galvanized steel bar grating, supported by galvanized steel framework attached to the fluid cooler. The platform shall be surrounded by a guardrail, kneerail, and toeboard.</p>	<ul style="list-style-type: none"> ■ Periodic inspection and maintenance of a fluid cooler distribution system is fundamental to preserving maximum cooling system efficiency. All fluid coolers—crossflow or counterflow—are subject to clogging to varying degrees by water-borne contaminants such as pipe scale and sediment. Therefore, safe and easy access to these components is of significant value to the operator. <p>Access can be provided in a number of ways, including portable ladders or scaffolding, but for maximum safety and convenience, a field installed Marley access platform with guardrails is available to make this task as safe and user-friendly as possible. Further, its location on the side of the tower does not add to the height of the unit, preserving architectural integrity. It also saves the owner time and money, in that maintenance personnel may devote their time to inspection rather than searching for ladders or erection of portable scaffolding.</p> ■ Many fluid coolers are installed such that the base of the unit is 610 mm or more above the roof or grade level. This makes it difficult to get up to the foot of the attached ladder. The ladder extension alleviates this problem. Marley ladder extensions are available in standard 1.5m and 3.4m lengths. ■ To meet OSHA guidelines, towers whose fan decks are 20'-0" (6.096m) or more above roof or grade, and which are equipped with ladders, should have safety cages surrounding the ladders, but with approximately 2m clear headroom. ■ Where fluid coolers are installed on an elevated grillage or piers, it is often difficult to get to—and through—the access door conveniently. This platform provides easy, safe, and comfortable access to that door. It also extends beyond the door to provide ready access to the optional Control System.

